



**TEST REPORT**

**Report No.:** G8784.01-109-44

**Rendered to:**

VELUX America LLC  
Greenwood, South Carolina

**PRODUCT TYPE:** Curb Mounted Skylight

**SERIES/MODEL:** Specials 0.118 Polycarbonate Single Dome Skylight

**SPECIFICATION:** Occupational Safety and Health Administration/U.S. Department of Labor  
Regulations (Standards- 29 CFR)- 1910.23(e)(8).

California Code of Regulations, Title 8, Section 3212

**Test Date(s):** 03/20/17

**Report Date:** 04/11/17

**Test Record Retention End Date:** 03/20/21

- 1.0 Report Issued To:** VELUX America LLC  
1418 Evans Pond Road  
P.O. Box 5001  
Greenwood, South Carolina 29648-5001
- 2.0 Test Laboratory:** Architectural Testing, Inc., an Intertek company ("Intertek-ATI")  
130 Derry Court  
York, Pennsylvania 17406-8405  
717-764-7700

### 3.0 Project Summary:

- 3.1 Product Type:** Curb Mounted Skylight
- 3.2 Series/Model:** Specials 0.118 Polycarbonate Single Dome Skylight
- 3.3 Compliance Statement:** Results obtained are tested values and were secured by using the designated test method(s).
- 3.4 Test Date(s):** 03/20/17
- 3.5 Test Record Retention End Date:** All test records for this report will be retained until March 20, 2021.
- 3.6 Test Location:** Intertek-ATI test facility in York, Pennsylvania.
- 3.7 Test Specimen Source:** The test specimen(s) was provided by the client. Representative samples of the test specimen(s) will be retained by Intertek-ATI for a minimum of two years from the test completion date.
- 3.8 Drawing Reference:** The test specimen drawings have been reviewed by Intertek-ATI and are representative of the test specimen(s) reported herein. Test specimen construction was verified by Intertek-ATI per the drawings on file with Intertek-ATI. Any deviations are documented herein or on the drawings.
- 3.9 List of Official Observers:**

<u>Name</u>	<u>Company</u>
Timothy J. McGill	Intertek-ATI
Richard E. Hartman III	Intertek-ATI

**4.0 Test Specification(s):**

Occupational Safety and Health Administration/U.S. Department of Labor Regulations (Standards- 29 CFR)- 1910.23(e)(8).

California Code of Regulations, Title 8, Section 3212

A 400 lbf weight, fabricated from a bag filled with lead shot, was placed on the center of the dome for a minimum of 60 seconds. The bag was removed and the test unit was inspected for any signs of damage or failure.

Additional Loading:

The specimen was taken to failure using sandbags placed on the center of the dome for a minimum of 60 seconds. The highest load causing penetration or damage was recorded.

**5.0 Test Specimen Description:**

**5.1 Product Sizes:**

Overall Area: 42.0 ft <sup>2</sup>	Width (inches)	Length (inches)
Overall size	77-3/4	77-3/4

Curb Dimensions	Width (inches)	Length (inches)	Height (inches)
Wood curb	75-1/4	75-1/4	5-1/2

**5.2 Frame Construction:**

Frame Member	Material	Description
Inner frame	Aluminum	Extruded
Dome clamp cover	Aluminum	Extruded

	Joinery Type	Detail
Skylight corners	Mitered	Miter cut and welded

## 5.0 Test Specimen Description: (Continued)

### 5.3 Weatherstripping:

Description	Quantity	Location
Custom-shaped gasket	1 row	Located around the interior perimeter of the inner frame
Gasket wick	4	One wick was located at each corner inside the custom-shaped gasket

**5.4 Glazing:** *No conclusions of any kind regarding the adequacy or inadequacy of the glazing in any glazed test specimen(s) can be made.*

Glazing Type	Glazing	Glazing Method
Monolithic	1/8" polycarbonate smooth	The glazing was set from the exterior onto a custom-shaped gasket against the extruded aluminum frame. The glazing was secured using an extruded aluminum dome clamp cover with a bead of sealant on the glazing. The dome clamp cover was secured using spring clips and #10 x 5/8" self-tapping pan head screws located 5" from the corners on two sides and at the midspan of all sides.

Location	Quantity	Daylight Opening (inches)	Glass Bite
Dome	1	72-1/4 x 72-1/4	1"

## 6.0 Installation:

The specimen was installed into a Spruce-Pine-Fir wood buck. The rough opening allowed for a 1/2" shim space.

Location	Anchor Description	Anchor Location
Aluminum frame	#8 x 1-3/4" pan head screw	8" from corners and spaced 12" on center

**7.0 Test Results:** The results are tabulated as follows:

**7.1 California (and OSHA) minimum loading**

Test Load	Load Location	Results
400 lbf	Center of dome	No visible damage

**Note:** The 400 lbf weight was gently applied perpendicular to the center of each dome. After 60 seconds of rest time, there was no visible damage to either skylight.

**7.2 Additional loading (applied on the same unit in the listed order):**

Test Method	Load Location	Results
500 lbf at rest	Center of dome	No visible damage
600 lbf at rest	Center of dome	No visible damage
700 lbf at rest	Center of dome	No visible damage
800 lbf at rest	Center of dome	No visible damage
900 lbf at rest	Center of dome	No visible damage
1000 lbf at rest	Center of dome	No visible damage
1100 lbf at rest	Center of dome	No visible damage
1200 lbf at rest	Center of dome	No visible damage
1300 lbf at rest	Center of dome	See note #1

**Note #1:** At 1300 lbs, the specimen deglazed causing an opening larger than one square foot.

Intertek-ATI will service this report for the entire test record retention period. Test records such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by Intertek-ATI for the entire test record retention period.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen(s) tested. This report may not be reproduced, except in full, without the written approval of Intertek-ATI.

For ARCHITECTURAL TESTING, Inc.

---

Richard E. Hartman III  
Technician

---

Ken R. Stough  
Lead Technician

REH:asm

Attachments (pages): This report is complete only when all attachments listed are included.


Appendix-A: Photograph(s) (1)

Appendix-B: Drawing(s) (0) Complete drawings packet on file with Intertek-ATI.

**Appendix A**  
**Photograph(s)**



**Photo No. 1**  
**View of Tested Specimen**

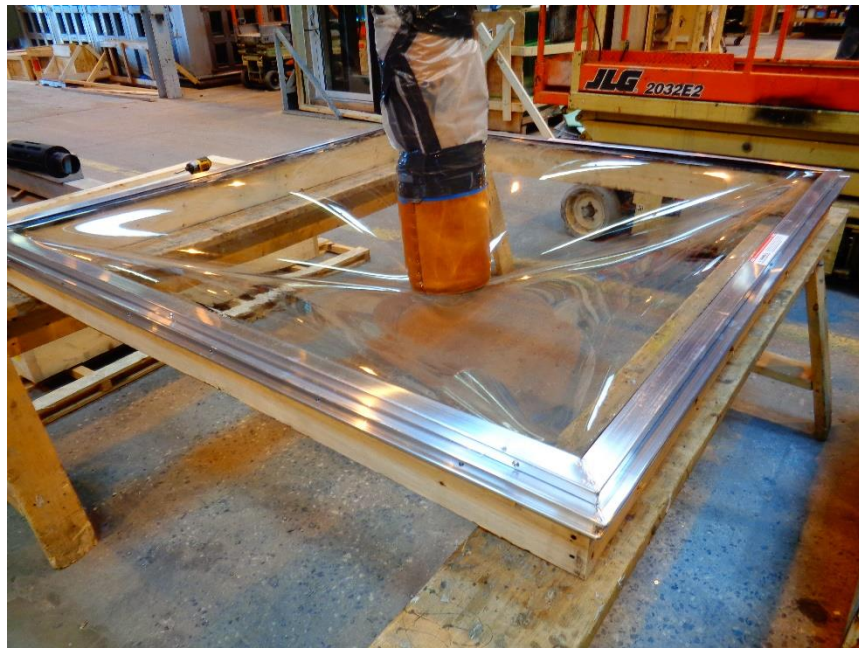

**Photo No. 2**  
**View of Tested Specimen with 400 lbs Applied**

**Appendix B**

**Drawing(s)**

***Note:** Complete drawings packet on file with Intertek-ATI.*